

Main and Branch Circuit Breakers[©]

| Breaker Type | Ampere Rating | Catalog Number | Catalog Number | UL Interrupting Ratings (kA) |
|-----------------|------------------|-------------------|-------------------------|------------------------------|
| QN | 150 | QN2150 | QN2150R ² | 10 |
| 2-Pole | 175 | QN2175■ | QN2175R ^② ■ | 10 |
| 120/240V AC | 200 | QN2200 | QN2200R ² | 10 |
| QNH | 150 | QN2150H | QN2150RH ² | 22 |
| 2-Pole | 175 | QN2175H■ | QN2175RH ² ■ | 22 |
| 120/240V AC | 200 | QN2200H | QN2200RH ² | 22 |
| HQN | 150 | HQN2150 | HQN2150R ² | 65 |
| 2-Pole | 175 | HQN2175■ | _ | 65 |
| 120/240V AC | 200 | HQN2200 | HQN2200R ² | 65 |






| For use in U | Iltimate Loa | d Centers | For use in E | For use in EQIII Load Centers | | | | | |
|--------------|------------------|-------------------|--------------|-------------------------------|-------------------|---------------------------------|--|--|--|
| UL Type | Ampere Rating | Catalog Number | UL Type | Ampere Rating | Catalog Number | UL Interrupting Ratings (kA) | | | |
| EQ8681 | 100 | MBK100A | EQ9675 | 100 | MBK100 | 22 | | | |
| EQ8682 | 125 | MBK125A | EQ9677 | 125 | MBK125 | 22 | | | |
| EQ8693 | 150 | MBK150A | EQ9683 | 150 | MBK150 | 22 | | | |
| — | I <i>-</i> | _ | EQ9684 | 175 | MBK175■ | 22 | | | |
| EQ8695 | 200 | MBK200A | EQ9685 | 200 | MBK200 | 22 | | | |
| EQ8696 | 225 | MBK225A | EQ9686 | 225 | MBK225 | 22 | | | |

| Breaker Type | Ampere Rating | Catalog Number | UL Interrupting Ratings (kA) |
|------------------|------------------|-------------------|---------------------------------|
| QPJ [®] | 125 | QPJ3125 | 10 |
| 3-Pole | 150 | QPJ3150 | 10 |
| 240V AC | 200 | QPJ3200 | 10 |

Requires 6 spaces due to cross over design. Fits only EQIII 125-400A 3-phase load centers


SHIPPING: 5 per carton (Wt. 17 lbs.)

| Breaker Type | Ampere Rating | Catalog Number | UL Interrupting Breaker Ratings (kA) Volts AC 120/240 |
|-----------------|------------------|-------------------|---|
| | 125 | Q2125B | 10 |
| QPP | 150 | Q2150B | 10 |
| 2-Pole | 175 | Q2175B■ | 10 |
| 120/240V AC | 200 | Q2200B | 10 |
| | 225 | Q2225B | 10 |
| | 125 | Q2125BH | 22 |
| ОРРН | 150 | Q2150BH | 22 |
| 2-Pole | 175 | Q2175BH■ | 22 |
| 120/240V AC | 200 | Q2200BH | 22 |
| | 225 | Q2225BH■ | 22 |
| | 125 | Q2125BHH■ | 65 |
| HOPP | 150 | Q2150BHH | 65 |
| 2-Pole | 175 | Q2175BHH■ | 65 |
| 120/240V AC | 200 | Q2200BHH | 65 |
| | 225 | Q2225BHH■ | 65 |
| | 100 | HQ2100BH■ | 100 |
| | 125 | HQ2125BH■ | 100 |
| HQPPH | 150 | HQ2150BH■ | 100 |
| 2-Pole | 175 | HQ2175BH■ | 100 |
| 120/240V AC | 200 | HQ2200BH■ | 100 |
| | 225 | HQ2225BH■ | 100 |











For inches / millimeters conversion, see Application Data section. ■ Built to order. Allow 2–3 weeks for delivery.

<sup>O All circuit breakers on this page are common trip.
Reverse handle.
CSA Listed.
MBK100A for use in 100 and 125A load centers.
MBK125A for use in 125A load centers.
MBK150A for use in 125A load centers.
MBK150A for use in 250, 200 and 225A load centers.
MBK225A for use in 200 and 225A load centers.
MBK225A for use in 200 and 225A load centers.
MBK175A for use in 200 and 225A load centers.</sup>

[®] QNR required for horizontal applications or vertical applications where the lugs are facing up. The QN breaker is required for vertical applications where the lugs are facing down as shown.

Revised

01/22/13





Utility Specific, Over/Under Meter-Load Center Combination, 1-Phase, 3-Wire 120/240V AC

- UL listed
- Overhead and underground feed applications
- Load wires bottom or back exit only
- 22,000 AIC rated, or as noted
- Pad locking provisions on all devices
- Side hinge doors removable by backing out only one screw
- Suitable for use only as service entrance equipment
- Contact local utility to confirm meter socket placement prior to installation
- See end of section for dimensions and wiring diagrams



200A offset design with feed thru lugs

| | Amp | | | | | Diment | tions (inc | hes) | | Short | | | |
|--|----------------|---------------------|------|------------------|-----------------|--------|------------|------|-----------------|-------------------|------------------|------------|---------------|
| Catalog Number | Rating (Cont.) | Utility Incoming | / | No. of Spaces | No. of Circuits | н | w | D | Main Breaker | Circuit Rating | Hub Provision | 5th Jaw | Cover Type |
| Meter-Load Center Combination, 150-200amp, Sidewire (Underground Feed Only) ^② | | | | | | | | | | | | | |
| MC0606L1200RAD ³ | 200 | UG | None | 6 | 6 | 25.0 | 17.0 | 5.2 | Main Lug | 10,000 | HC-bot | EC5J2 | Dinalose |
| MC0816B1200RTD ⁴ | 200 | UG | None | 8 | 16 | 29.0 | 17.0 | 5.2 | MBK200 | 22,000 | HC-DOI | EC5J2 | Ringless |

Meter-Load Center Combination Approved for Georgia Power, 150-200A

| MC040 | 08B1150RGA@ | 150 | | | | | 22.5 | | | MBK150 | | | | | | | | | | | | | | |
|-------|--------------------------|-----|-------|------|----|----|------|------|-----|----------|--------|-------------------|-------|----------|--|---|----|------|--|--|--------|--|--|--|
| MC040 | 08B1200RGA [@] | 200 | | | 4 | 8 | 33.5 | | | MBK200 | | | | | | | | | | | | | | |
| MC060 | 06L1200RGA | 200 | OH/UG | None | 12 | 6 | 30.5 | 15.0 | 5.1 | Main Lug | 22,000 | RX-top, HC-bot | EC5J2 | Ringless | | | | | | | | | | |
| MC081 | 16B1150RGA ^{①④} | 150 | | | | | | | | | | | | | | 0 | 16 | 05.5 | | | MBK150 | | | |
| MC081 | 16B1200RGA [@] | 200 | | | 8 | 16 | 35.5 | | | MBK200 | | | | | | | | | | | | | | |

① Suitable for use as service entrance equipment when not more than six disconnecting means are provided and when not used as a lighting an appliance panel


② Due to wire space restrictions on the trough side, the left side of the interior is limited to a 60A max branch.

³ Aluminum enclosure.


[@] Feed thru lugs included.

Meter Centers


Meter Combinations Dimensions and Wiring Schematics

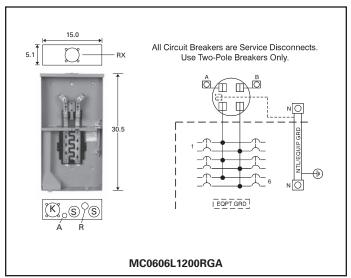


■ Product tables for above on page 2-24

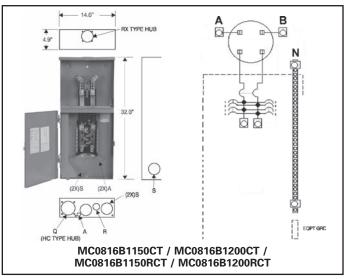


■ Product tables for above on pages 2-23 and 3-28

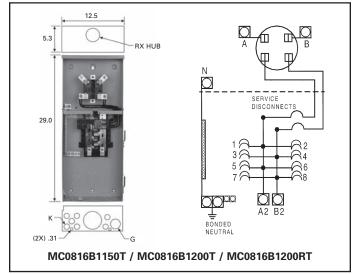

■ Product tables for above on pages 2-23 and 3-29

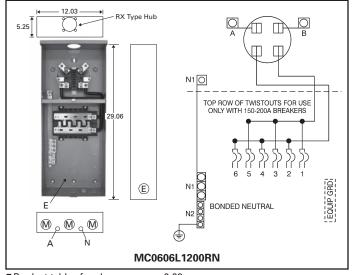

■ Product tables for above on page 2-23

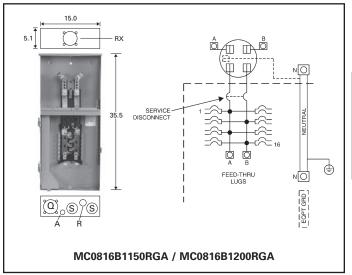

■ Product tables for above on page 2-24

| $A = \frac{1}{2}$ | L = 3%, 1/2, 3/4 |
|--|--|
| $B = \frac{1}{2}, \frac{3}{4}$ | M = ¾, 1, 1¼, 1½, 2 |
| $C = \frac{1}{2}, \frac{3}{4}, 1$ | N = 1/4 |
| $D = \frac{3}{4}, \frac{1}{4}, \frac{1}{2}$ | P = 2, 2%, 3, 3%, 4 |
| $E = 1, 1\frac{1}{4}, 1\frac{1}{2}, 2$ | Q = 2%, 3 |
| $F = \frac{3}{4}, 1, 1\frac{1}{4}$ | $R = \frac{1}{2}, \frac{3}{4}, 1, 1\frac{1}{4}$ |
| $G = 1, 1\frac{1}{4}, 1\frac{1}{2}$ | $S = \frac{1}{2}, \frac{3}{4}, 1, 1\frac{1}{4}, 1\frac{1}{2}, 2, 2\frac{1}{2}$ |
| $H = 1, 1\frac{1}{4}, 1\frac{1}{2}, 2, 2\frac{1}{2}$ | T = 1%, 2, 2% |
| J = 1%, 1%, 2, 2%, 3 | U = ¾, 1, 1¼, 1½, 2, 2½, 3 |

Knockout Code — Conduit Sizes

K = 1, 1%, 2, 2%, 3 V = %, 1, 1%, 1%

Combination Meter Sockets

MURRAY

Catalog Number Logic

